

1. Start Container

1. For "cold" start, you need switch on all circuit breakers on Power Distribution Cabinet.
2. Wait 2-3 minutes for start and load all systems and computers.
3. Connect to web-interface of main container computer (10.3.x.x).

Figure 1 Web-interface of container computer


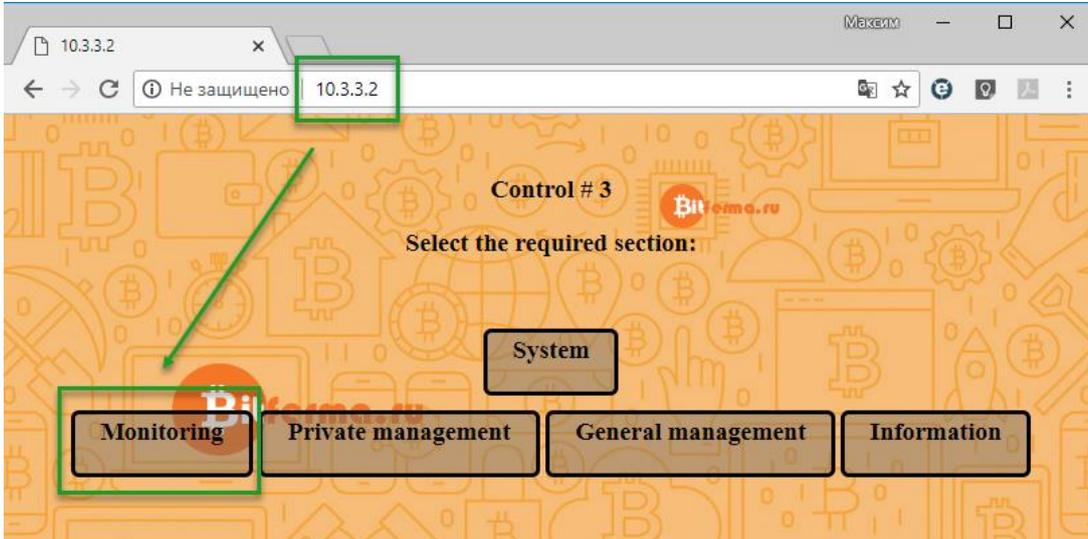


Figure 2 Monitoring page

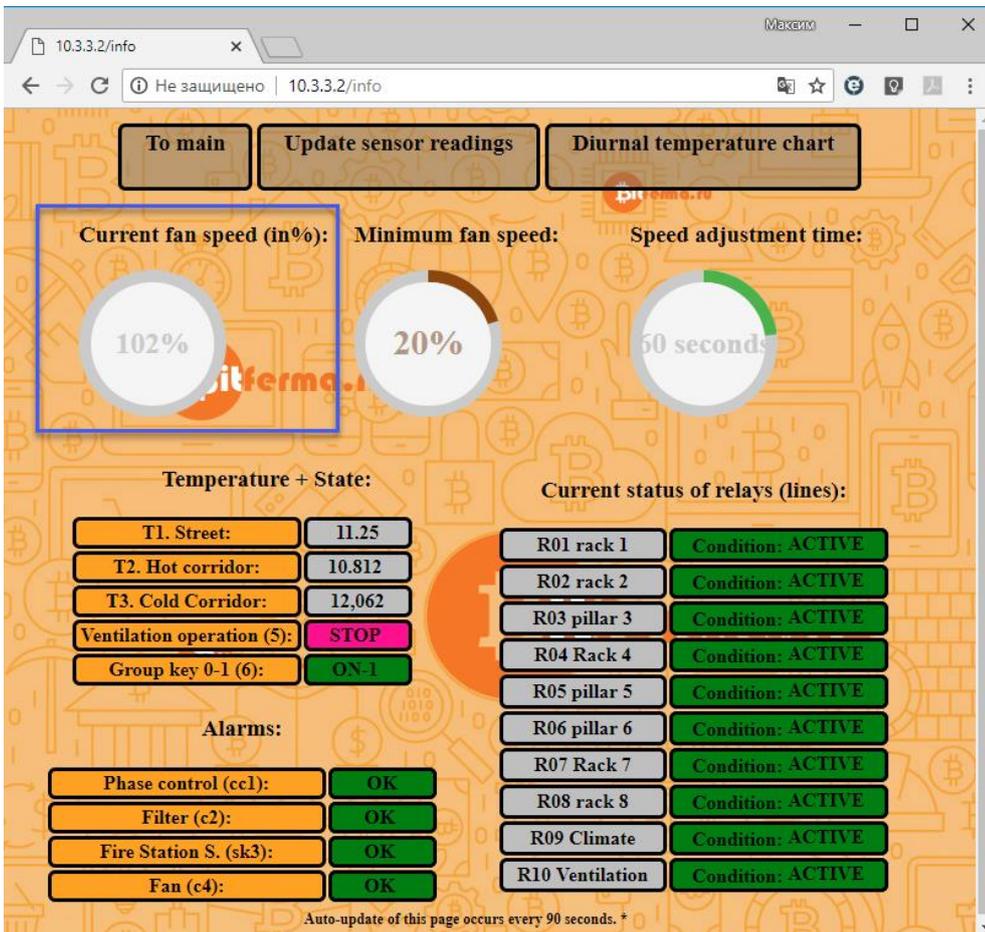

4. Check value of temperature sensors and current fan speed.

II. Warm start